


TOP VIEW CABLE OPENINGS (COVERS REMOVED)

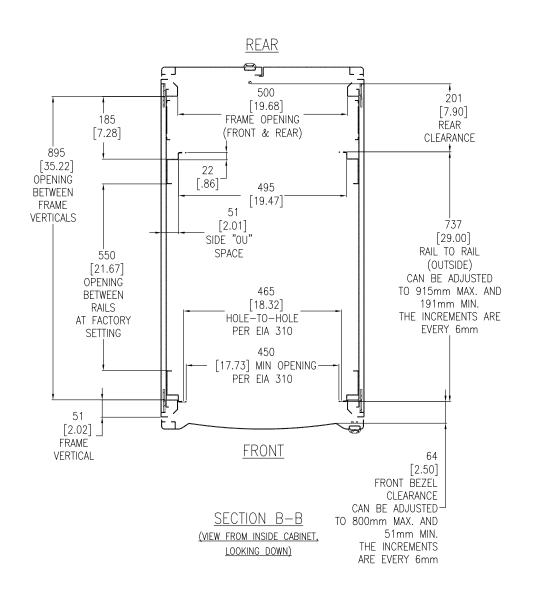

NOTES:


- 1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL AND LOCAL CODES.
- 2. ALL DIMENSIONS ARE MILLIMETERS [INCHES].

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE



TITLE:
NetShelter SX 42U
ENCLOSURE WITHOUT SIDES
600mm WIDE x 1070mm DEEP
TOP VIEWS

			DWG NO:	RJ	3 ⁻	1 0 1	REV.
			DRAWN BY:	V Bl	JSH	15-APR-11	FIRST
	TOP VIEWS	ENGINEER:	Y W	ANG	15-APR-11	ANGLE	
	PROJECT: SUBMITTAL DRAWINGS	SHEET 2 OF 3	APPROVED BY:	T HORSTM	ANN	15-APR-11	PROJ

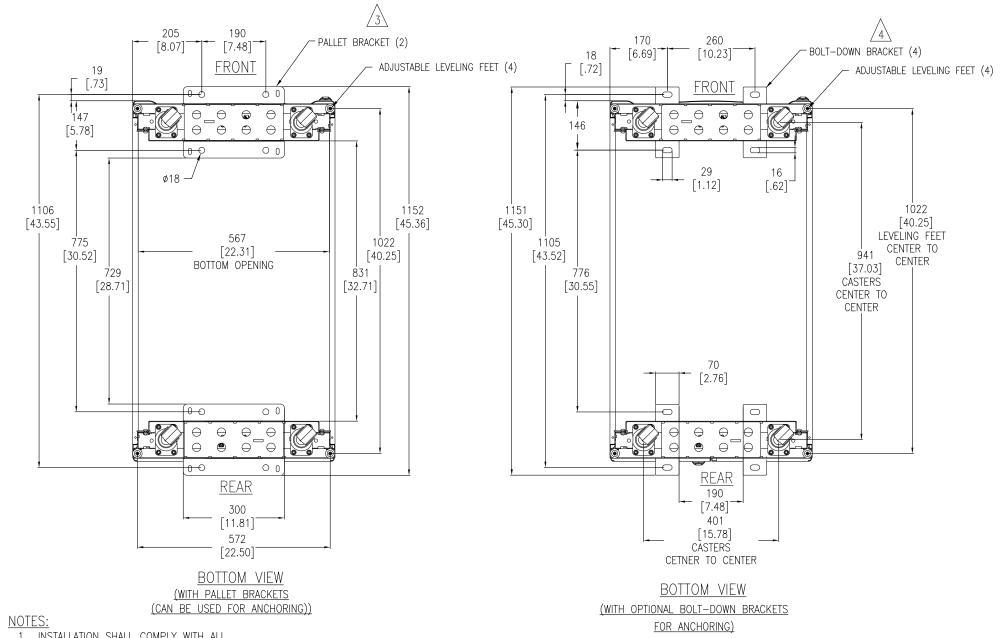

- 1. INSTALLATION SHALL COMPLY WITH ALL APPLICABLE NATIONAL AND LOCAL CODES.
- 2. ALL DIMENSIONS ARE MILLIMETERS [INCHES]
- △ 3. ANCHORING CAN BE INSTALLED EITHER INSIDE OR OUTSIDE THE NetShelter WITH ONE AT FRONT AND ONE IN BACK.
- △ 4. BOLT-DOWN KIT (SKU# AR7701) IS OPTIONAL AND HAS TO BE ORDERED SEPARATELY.

THIS DRAWING AND SPECIFICATIONS HEREIN ARE THE PROPERTY OF SCHNEIDER ELECTRIC AND SHALL NOT BE COPIED, REPRODUCED OR USED IN WHOLE OR IN PART, AS THE BASIS FOR THE MANUFACTURE OR SALE OF ITEMS WITHOUT WRITTEN PERMISSION FROM SCHNEIDER ELECTRIC. THIS DRAWING IS BASED UPON LATEST AVAILABLE INFORMATION AND IS SUBJECT TO CHANGE WITHOUT NOTICE

Schneider Electric

HHE	•						
	N	etShel	ter	SX	42U		
	ENCLO	SURE	W	ITHO	UT S	IDES	
	600mm					DEEF	כ
		BOTT	MC	VIE	NS		

DRAWN BY V BUSH FIRST ENGINEER: 15-APR-11 ANGLE Y WANG PROJECT: SUBMITTAL DRAWINGS SHEET 3 OF 3 APPROVED BY: T HORSTMANN 15-APR-11 PROJ